

DEMKO CERTIFICATE

Certificate No. 315075-01
Page 1/3
Date of Issue 2009-09-16

Certificate Holder Nordisk Wavin A/S
Wavinvej 1
DK-8450 Hammel, DENMARK

Manufacturer Nordisk Wavin A/S
Wavinvej 1
DK-8450 Hammel, DENMARK

Production site Nordisk Wavin A/S
Wavinvej 1
DK-8450 Hammel, DENMARK

Certified Product Conduit for electrical installations
Model See appendix
Trademark Wavin

Rated Voltage / Frequency -
Rated Current / Power -
Insulation Class -
Degree of protection (IP) -

Tested acc. to EN 61386-1:2008, EN 61386-21:2004
Test Report No. -
Additional See appendix
Expire date 2014-08-21

Certification Manager
Jan-Erik Storgaard

Certification Body

The product and production sites listed on the certificate comply with the D-mark requirements and the UL Global Service Agreement, with reference to Terms and Conditions for the D mark. The Owner of the certificate is entitled to use the ® or for cables «DEMKO» for the products listed on the certificate and manufactured at the production sites listed. UL has to be informed in writing about any changes to the product or production site in accordance with the Term and Conditions of the D mark. The validity of the certificate is shortened if the EU legislation require re-testing and re-certification due to new standards or amendments coming into force before the expiry date.

UL International Demko A/S, Lyskaer 8, P.O. Box 514, DK-2730 Herlev, Denmark, Tel. +45 44 85 65 65, info.dk@dk.ul.com
www.ul-europe.com

Appendix DEMKO CERTIFICATE

Certificate No. 315075-01
Page 2/3
Date of Issue 2009-09-16

Model and technical information ;

16

Pliable corrugated conduits of insulating material.

Temperature range -25°C / +60°C.

Resistance to impact 2J. Resistance to compression 750N.

Non-flame propagating conduit.

Classification coding 3341.

Lead free. PVC conduit VP; outer diameter: 16mm

20

Pliable corrugated conduits of insulating material.

Temperature range -25°C / +60°C.

Resistance to impact 2J. Resistance to compression 750N.

Non-flame propagating conduit.

Classification coding 3341.

Lead free. PVC conduit VP; outer diameter: 20mm

25

Pliable corrugated conduits of insulating material.

Temperature range -25°C / +60°C.

Resistance to impact 2J. Resistance to compression 750N.

Non-flame propagating conduit.

Classification coding 3341.

Lead free. PVC conduit VP; outer diameter: 25mm


The certificate has been issued on the basis of Nordic certification Service, certificate No. 907777, issued by Intertek Semko, dated 2009-08-21

Certification Body

UL International Demko A/S, Lyskaer 8, P.O. Box 514, DK-2730
Herlev, Denmark, Tel. +45 44 85 65 65, info.dk@dk.ul.com
www.ul-europe.com

Appendix DEMKO Certificate

Certification Mark	D-mark
Certificate No.	315075-01
Page	3/3
Date of Issue	2009-09-16

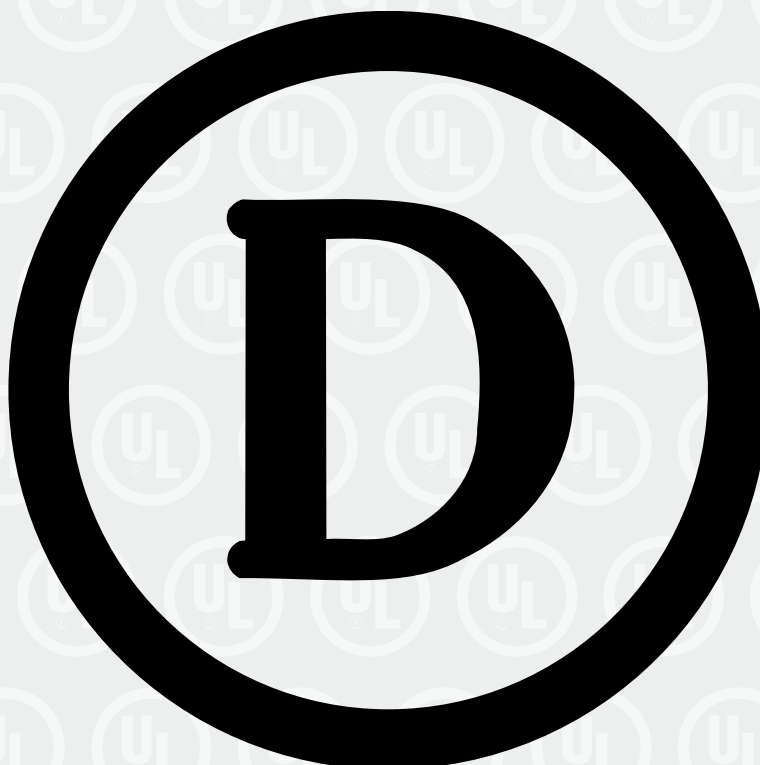

Certification Body

UL International Demko A/S, Lyskaer 8, P.O. Box 514, DK-2730
Herlev, Denmark, Tel. +45 44 85 65 65, info.dk@dk.ul.com
www.ul-europe.com